


AIRIUS CEILING KIT MOUNTING GUIDELINES - Model 10, 15, 25, (Option 1)


PLUG NOT SUPPLIED

Unistrut or Ceiling Beam

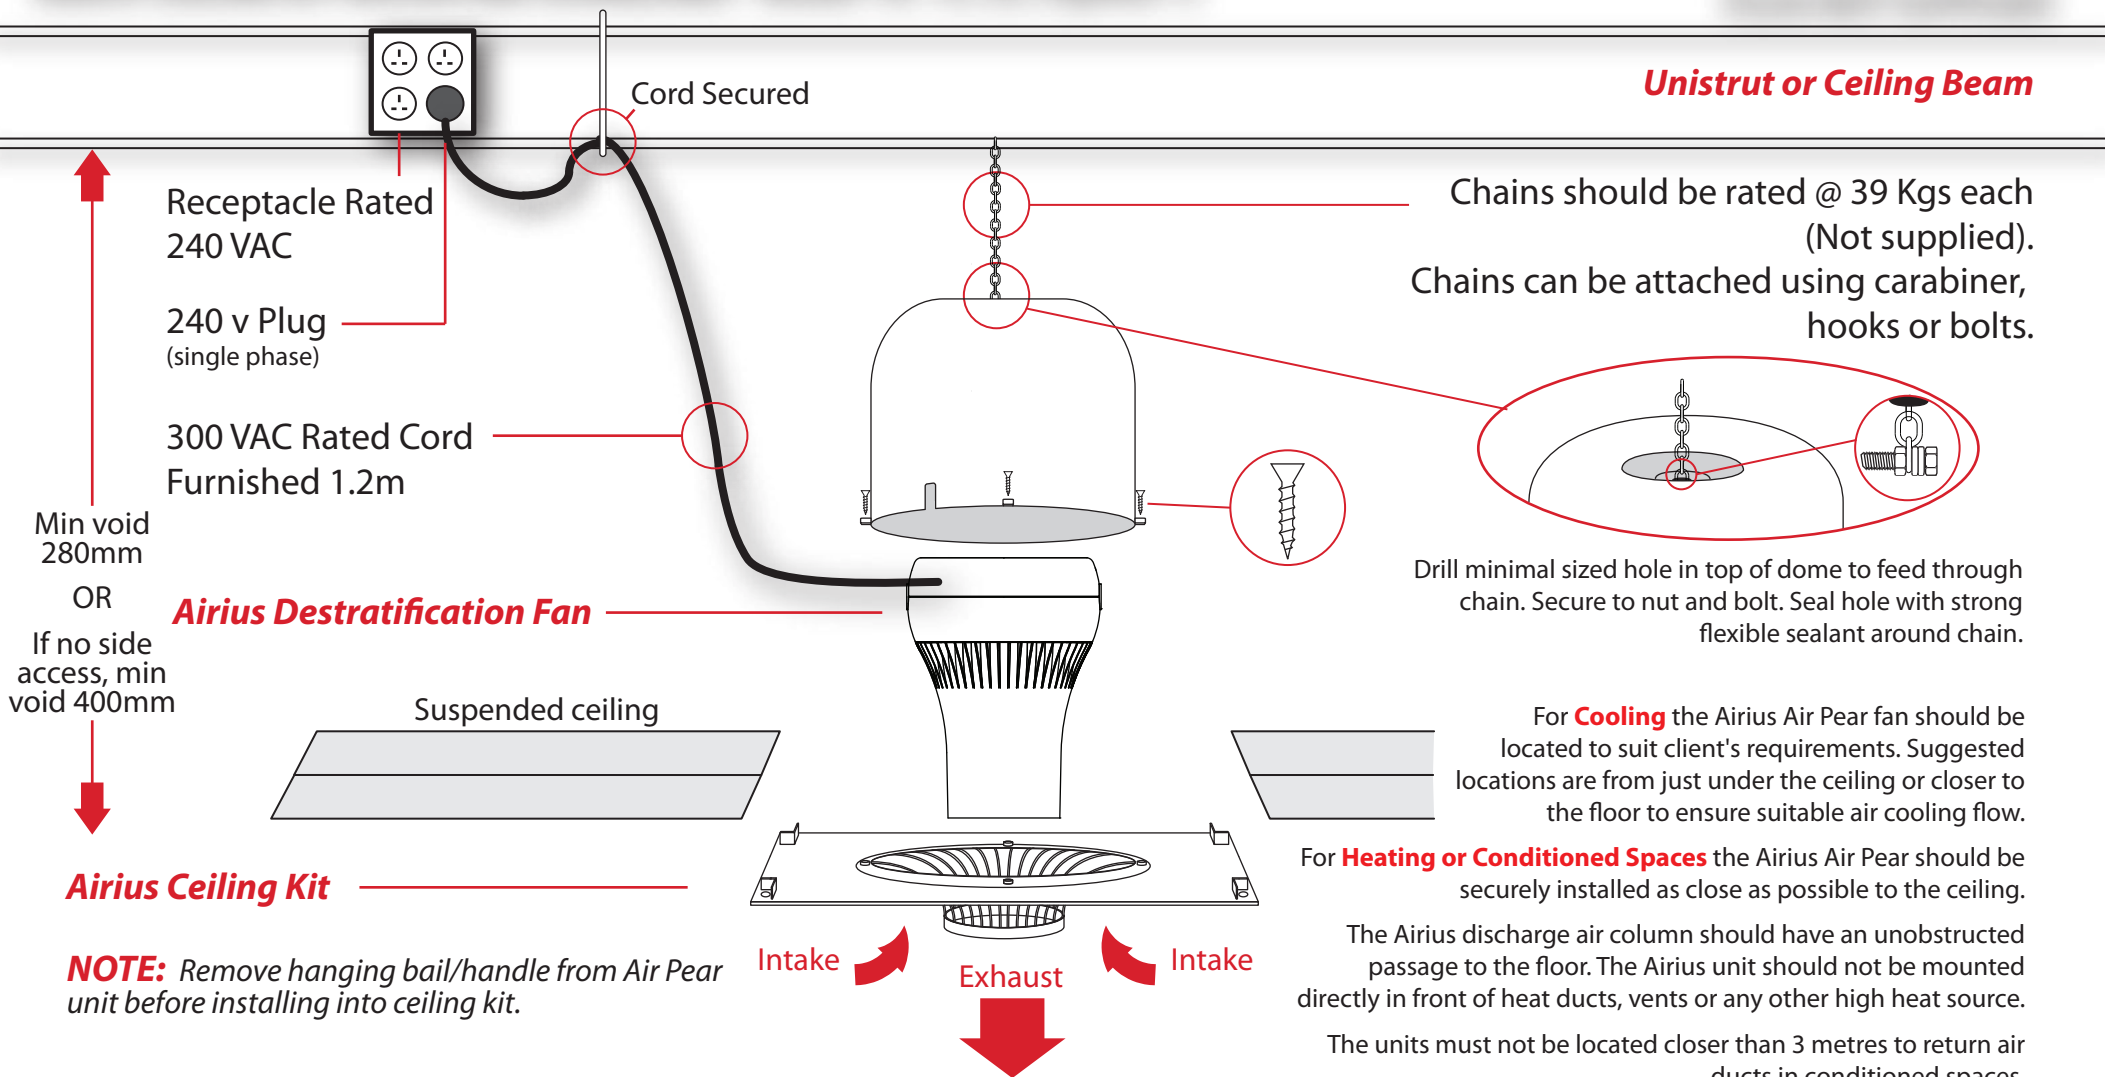

Min void 280mm
OR
If no side access, min void 400mm

Airius Destratification Fan

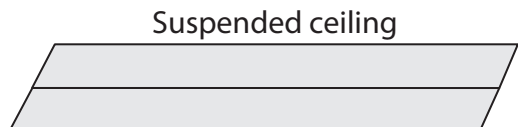


Airius Ceiling Kit

NOTE: Remove hanging bail/handle from Air Pear unit before installing into ceiling kit.

AIRIUS CEILING KIT MOUNTING GUIDELINES - Model 10, 15, 25, (Option 2)

PLUG NOT SUPPLIED

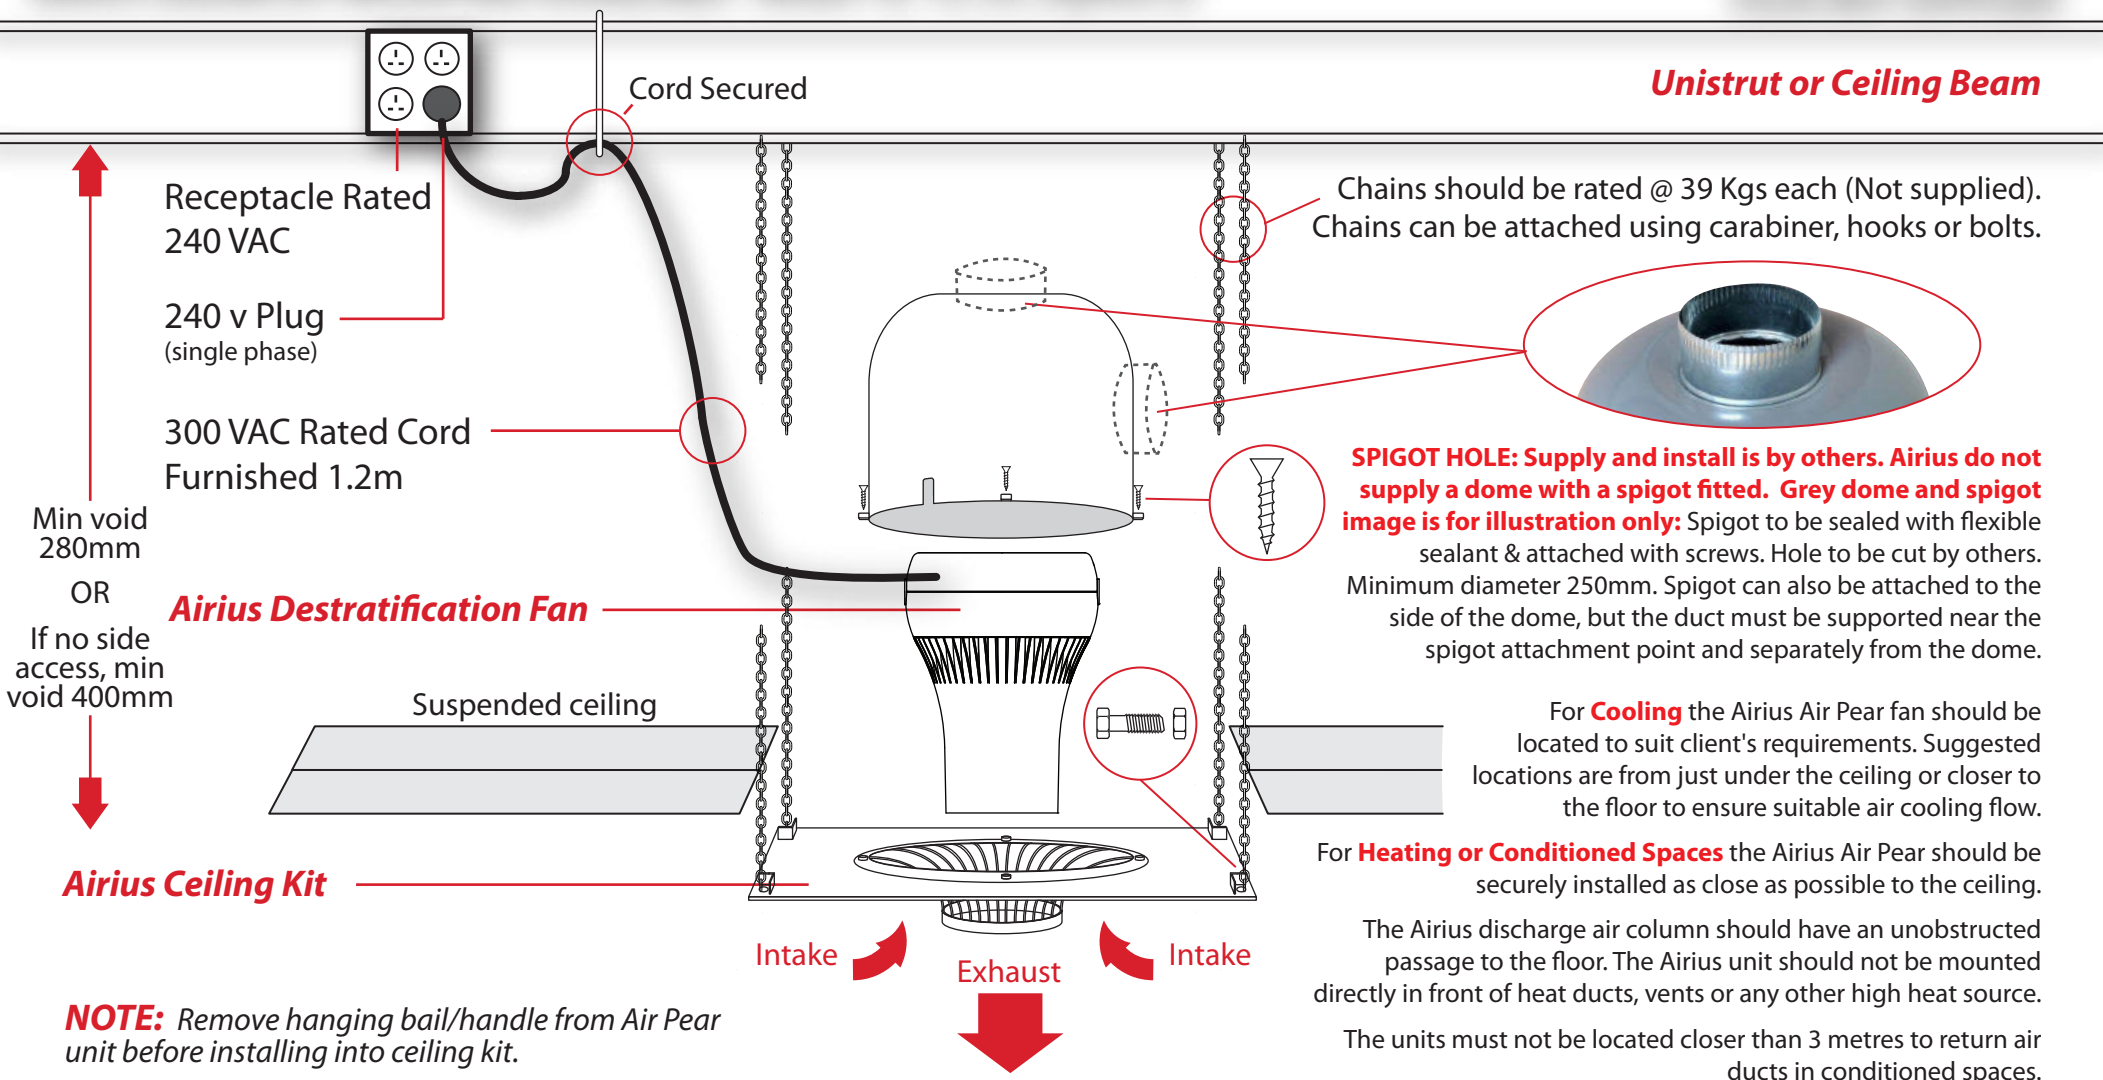

Unistrut or Ceiling Beam

Min void 280mm
 OR
 If no side access, min void 400mm

Airius Destratification Fan

Airius Ceiling Kit

NOTE: Remove hanging bail/handle from Air Pear unit before installing into ceiling kit.