


## AIRIUS CEILING KIT MOUNTING GUIDELINES - Model 45 (Option 1)


**PLUG NOT SUPPLIED**

**Unistrut or Ceiling Beam**

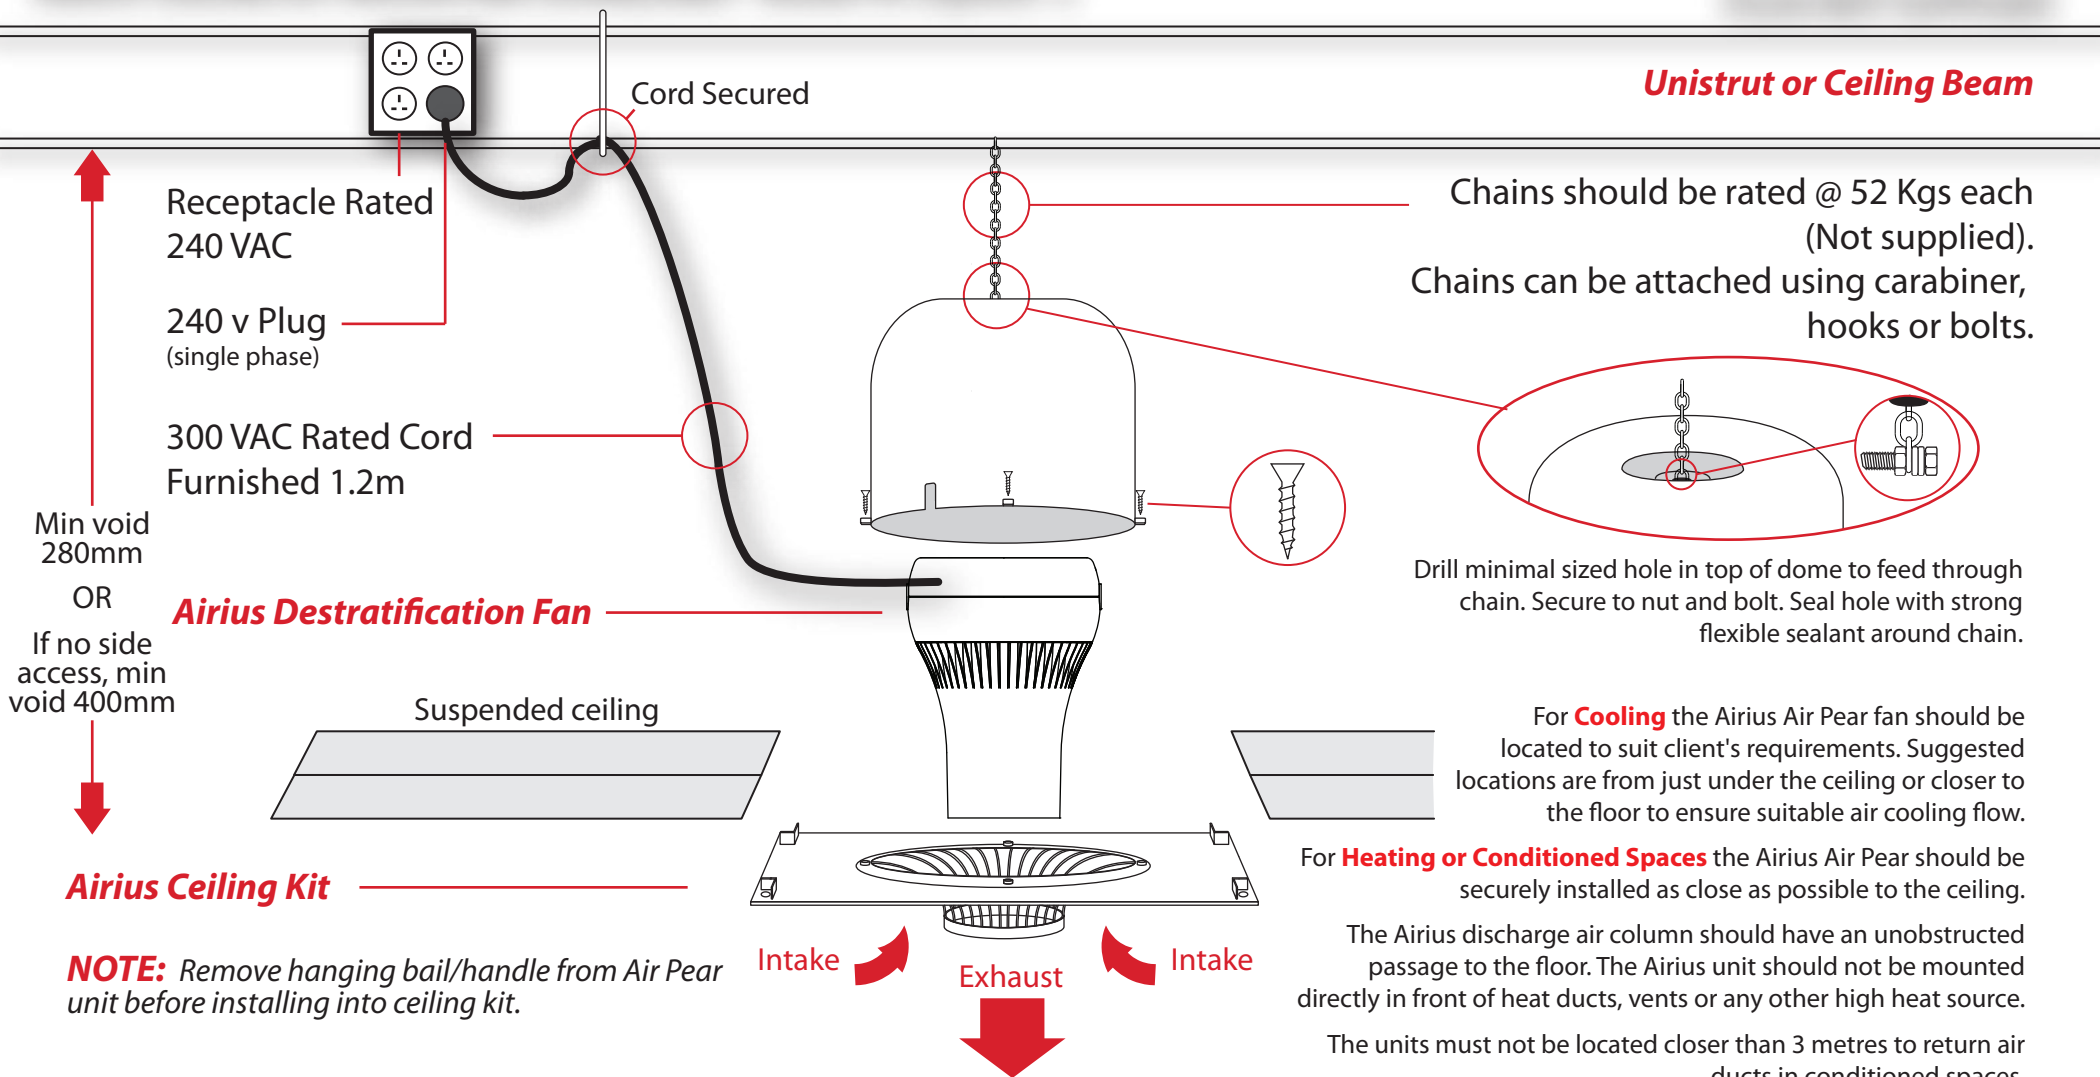

## AIRIUS CEILING KIT MOUNTING GUIDELINES - Model 45 (Option 2)

**PLUG NOT SUPPLIED**

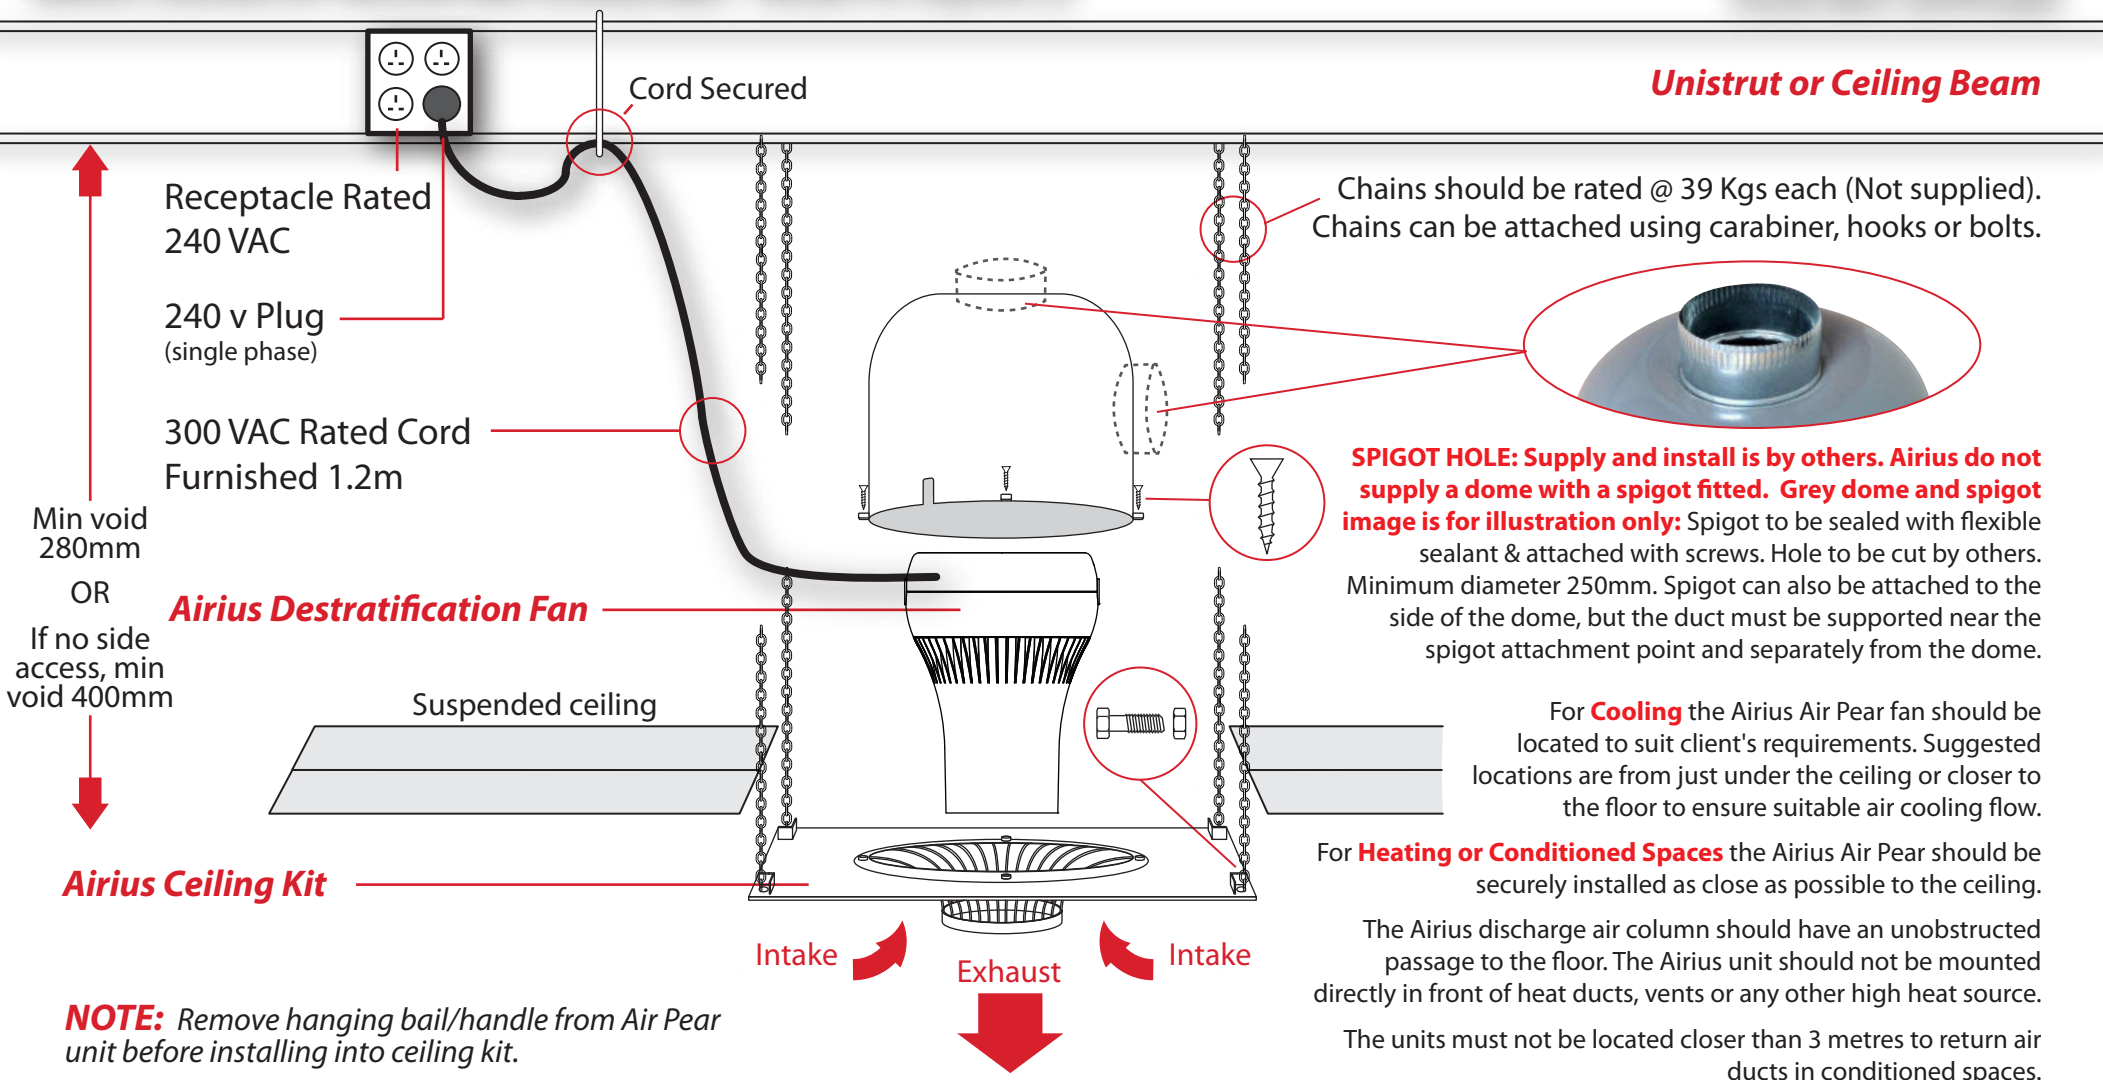

**Unistrut or Ceiling Beam**

Min void 280mm  
OR  
If no side access, min void 400mm

**Airius Destratification Fan**

Suspended ceiling

**Airius Ceiling Kit**

**NOTE:** Remove hanging bail/handle from Air Pear unit before installing into ceiling kit.